



Typical Specifications for DynaFlame Heating – Condensing Models DF(N,P)W 0502-6024, Stainless Steel

The hydronic heating boiler shall be a CAMUS DYNAFLAME model _____ having an input rating of _____ BTU (kW)/hr. and _____ BTU (kW)/hr. output for hydronic heating.

The hydronic heating boiler shall be design certified by CSA International and shall meet the requirements of ANSI Z21.13, and CSA 4.9. The hydronic heating boiler shall be vented as a Category II or IV near-condensing appliance.

The boiler shall comply with the energy efficiency requirements of the latest edition of ASHRAE 90.1 standard

Performance Overview:

- Boiler shall operate up to 95% thermal efficiency
- Heat exchanger shall be cylindrical 36 tube (Models 502 – 1202), 60 tube (Models 1502– 2502), 72 tube (Models 3002 – 3502), 78 tube (Models 4002 – 5002) and 96 tube (Models 4524 – 6024) SA268 439 stainless steel alloy tubes, with SA240 304/316L stainless steel headers and all gasket-less sealed design.
- Fine-tuned combustion premix providing homogeneous air and gas combustion mix to a radial burner incorporating a knitted stainless steel wrap ensuring stable light off and efficient clean combustion.
- 5:1 gas input turn down ratio with sustained efficient combustion characteristics throughout entire modulating range
- Oxides of Nitrogen (NOx) of 9 ppm maximum, corrected to 3% oxygen.
- Category II venting certification with Category II and Category IV available
- The boiler is fully factory fire tested to obtain optimum combustion characteristics and to establish certified gas input rates.
- System safety and operating devices and controls are fully configured, calibrated and factory tested.
- Models consist of an input range of 500 MBTUH to 6000 MBTUH
- The boiler shall comply with the energy efficiency requirements of the latest edition of the ASHRAE 90.1 Standard

Combustion Chamber:

The combustion chamber shall be constructed of stainless steel, sealed water tight, chamber to be covered with minimal ¼” thick ceramic insulation. A stainless steel access door shall be provided for ease of service and inspection to the outer heat exchanger surface and an easily removable radial fired knitted fiber stainless steel burner to access the internal combustion chamber for inspection, service, and cleaning. A window view port shall be provided for visual inspection of the boiler combustion during firing.

Heat Exchanger:

The heat exchanger shall be tested and inspected to A.S.M.E. Section IV requirements. The A.S.M.E. Section IV seal of approval will not be provided as standard for jurisdictions not requiring the A.S.M.E. Section IV seal of approval. The heat exchanger shall be a six pass design with a maximum working pressure of 160psig (1100kPa). The heat exchanger shall be of 439 grade stainless steel welded construction with a vertical cylindrical counter-flow, water tube design, complete with integral 439 stainless finned heater transfer tubes and 304/316L waterways.

Gas Train:

The gas train shall consist of a pressure regulating electro-hydraulic proportional air/gas main gas actuator providing a slow opening, fast closing shutoff valve and proportional 1:1 air/gas ratio control, a fast closing safety shutoff gas solenoid, and a low gas pressure switch. Optional high gas pressure switch is available. A factory pre-set combination metering valve and orifice shall be provided for setting combustion parameters. Models DF 502 – DF 6024 operate with a 5:1 turndown ratio.

Burner/Combustion:

The combustion air fan draws gas under negative pressure and mixes it with air to generate a fine tuned air gas mixture which is delivered under positive pressure to the radial knitted stainless steel burner. Combustion modulation is established by a variable frequency drive on all models. The burner shall be a 100% stainless steel vertical mounted radial fired type with stainless knitted metal fiber construction. The burner shall combust a precise amount of premixed combustion air and gas to provide equal distribution of heat for heat transfer throughout the entire heat exchanger. Combustion products are exhausted under minimum back pressure. Combustion operates with a 5:1 turn down ratio while sustaining combustion characteristics throughout the entire modulating range. Operation of up to 95% thermal efficiency and shall be certified for Oxides of Nitrogen (NOx) of 9 ppm corrected to 3% oxygen.

Firing Mode:

The burner combustion shall operate as proportional modulating with a 5:1 turndown ratio with a minimum 20% firing rate. Multiple boiler “Cascade” firing algorithms are proportional modulation. Light off shall be at no more than 50% input to assure rumble free soft start. Combustion shall be optionally suitable for natural gas, propane and dual fuels operation.



Typical Specifications for DynaFlame Heating – Condensing Models DF(N,P)W 0502-6024, Stainless Steel

Controls:

Standard controls include a SOLA electronic proportional integrated combination ignition limit/operator control accurate to 1⁰F (0.5⁰C) having a 4-20 mA output signal suitable for control of a variable frequency motor drive for modulating fan speeds. Controls are lead lag "Cascade" ready for control of up to eight boilers c/w Indoor outdoor reset. Control shall be equipped and ready with 4-20 mA or 2-10Vdc input for remote set point or modulating control. Control is BMS Modbus RTU protocol ready and capable of other alternate protocol conversions with additional optional gateway protocol converter. Control shall be supplied with a 7" mounted touch screen display which shall also provide for control system configuration and set up, readouts of boiler target, differential and inlet/outlet temperatures as well as accumulated runtime, enunciator diagnostics, and firing rates. The display shall include real time data logging and support for up to eight (8) boilers. The complete control package shall be mounted on the front panel with a hinged door for easy access to all control modules. The boiler safety control string shall be furnished with controls for low gas pressure, fan air proving, blocked flue, high limit and flow switch. High gas pressure switch is standard on CSD1 equipped boilers and is standard on models 3000 and up. A flow switch and relief valve shall be provided for each unit. Additional control safeties shall include flame rectification, fan speed, and auto recycling high limit.

Ignition Module:

The ignition module shall employ a direct igniter with 3 tries for ignition followed by lockout for DF 502 - DF 2502. A proven pilot is used on DF 3002 – DF 6024. Trial for ignition shall proceed with 15 seconds between retries. Ignition control shall include times for pre-purge, pre-ignition, ignition, and post purge.

Venting Options:

The following venting options shall be utilized:

- Category II Venting – single or combined vent
- Category IV Outside Air (Horizontal & Vertical)
- Category IV Through-wall Venting (Horizontal & Vertical)
- Outdoor Venting
- Category II & IV Direct Venting

The following Category II vent material shall be utilized:

- 316L Stainless Steel
- AL29-4C for all system applications

The following Category IV vent material shall be utilized:

- Stainless or AL29-4C material, single or double wall, positive pressure rated

External Jacket and Fasteners:


The external jacket shall be of 430 stainless steel mirror finish panels and a powder paint coated access top cover assembled utilizing interference fit locks and minimal non-strip self-tap screws for ease of removal and access to the heat exchanger and combustion air / gas control.




Typical Specifications for DynaFlame Heating – Condensing Models DF(N,P)W 0502-6024, Stainless Steel

Engineer: _____ Job Location: _____ Date: _____
 Prepared by: _____ Buyer's Name: _____ Quote #: _____
 Job Name: _____ Buyer's Address: _____


DYNAFLAME 0502-1202

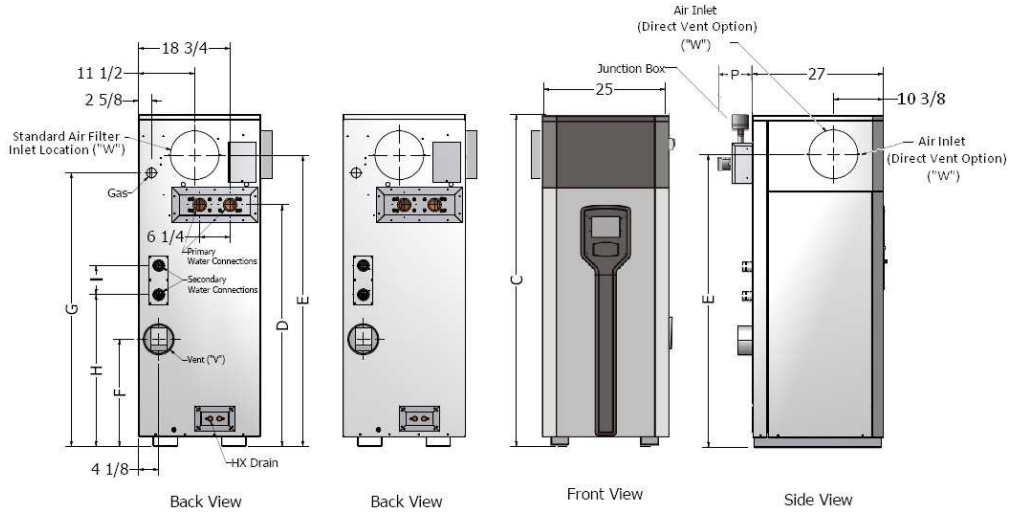

DYNAFLAME 1502-5002

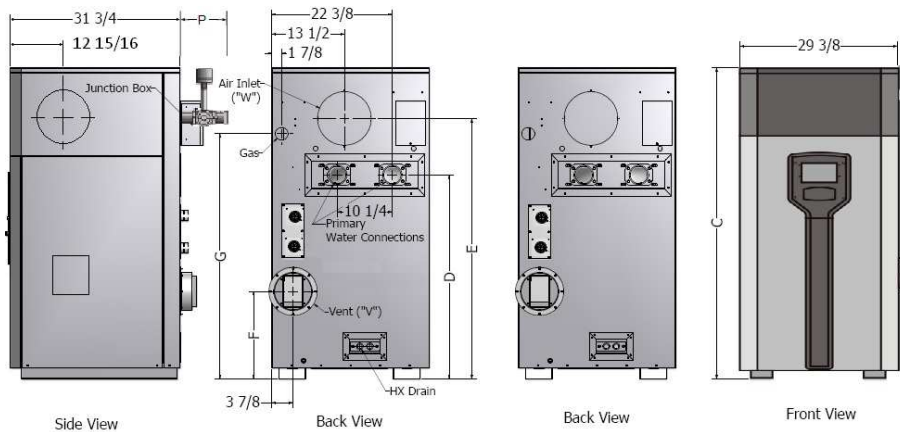

DYNAFLAME MEGA 4524-6024

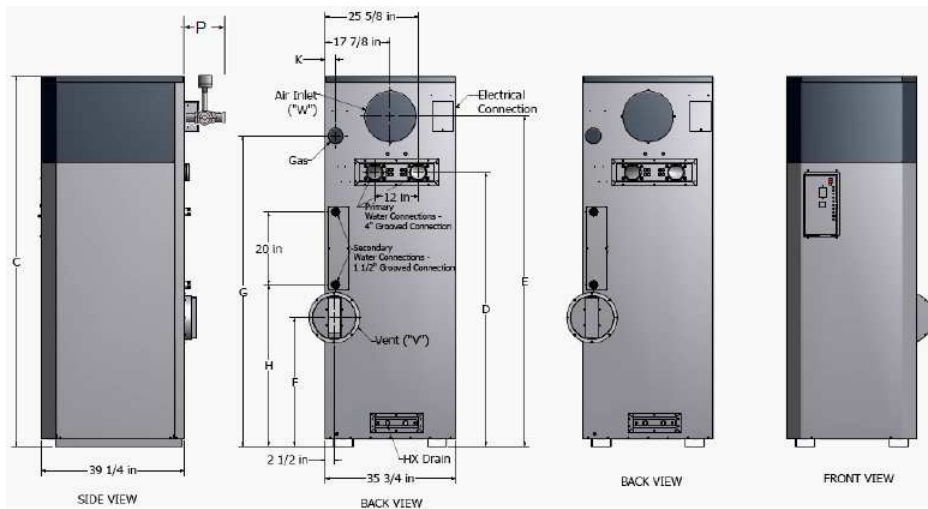



Typical Specifications for DynaFlame Heating – Condensing Models DF(N,P)W 0502-6024, Stainless Steel

Dimensions

Model	Height Dim.	Water Conn.	Air Inlet "E" [in.]	Flue Height "F"	Gas Height "G"	Air Inlet Dia.**	Dim. "P" [in.]	Water Conn.*	Gas Conn.	Dim. "K" [in.]
0502	45 5/8	27	37 1/4	13 1/4	33 5/8	6	5	2	1	--
0752	55	36 3/8	46 5/8	15 3/4	43	8	5	2	1	--
1102	68 1/4	49 5/8	59 7/8	22	56 1/4	8	5	2	1	--
1202	68 1/4	49 5/8	59 7/8	22	56 1/4	8	5	2	1	--
1502	58 1/8	38 1/4	48 5/8	16 3/8	45 7/8	10	5	2 1/2	1 1/4	--
1752	62 5/8	42 5/8	53 1/8	16 3/8	50 3/8	10	5	2 1/2	1 1/4	--
2002	66 7/8	46 7/8	57 3/8	20	53 5/8	12	5	3	1 1/4	--
2502	73 1/2	52 5/8	63 5/8	25 3/4	60 3/8	12	5 1/2	3	1 1/2	--
3002	79 1/2	58 5/8	69 5/8	31 3/4	66 3/8	12	5 1/2	3	1 1/2	--
3502	86 1/2	63 5/8	76	24 7/8	72 5/8	14	6	4	2	--
4002	91 1/2	68 5/8	81	29 7/8	77 5/8	14	6	4	2	--
4502	96 1/2	73 5/8	86	34 7/8	82 5/8	14	31	4	2 1/2	--
5002	101 1/2	78 5/8	91	39 7/8	87 5/8	14	31	4	2 1/2	--
4524	83	59 3/4	72 1/4	20 3/4	67 7/8	14	31	4	2 1/2	3 1/2
5024	88 1/4	65	77 1/2	26	72 1/4	14	31	4	2 1/2	3 1/2
6024	102	75 1/2	91	35 1/2	85 1/2	14	31	4	3	2 3/4

*Recommended pipe size. Models 1500-5000 Appliance Inlet/Outlet Connections are 3", all units are groove-locked type.

**Recommended size of air inlet pipe, actual air inlet opening at filter may be one size larger than shown

Primary Heat Exchanger Head Loss and Flow

Model	Temperature Rise Across Heat Exchanger			
	20°F		30°F	
	USGPM	ΔP-Ft.	USGPM	ΔP-Ft.
0502	42.0	1.5	28.0	0.7
0752	63.0	3.0	42.0	1.4
1102	92.4	5.9	61.6	2.8
1202	102.0	4.4	68.0	2.0
1502	125.9	8.3	83.9	3.8
1752	135.0	12.5	90.0	6.0
2002	167.9	6.7	111.9	3.2
2502	209.9	8.4	139.9	3.9
3002	251.9	9.9	167.9	4.7
3502	297.2	11.8	198.1	5.6
4002	340.4	17.1	226.9	8.1
4502	382.1	28.4	254.7	13.3
5002	424.4	31.1	282.9	14.7
4524	382.1	20.4	254.7	9.7
5024	424.4	23.5	282.9	11.2
6024	509.3	38.0	339.5	18.0

Secondary Heat Exchanger Head Loss and Flow

Model	10°F Temperature Rise Across Heat Exchanger	
	US GPM	ΔP-Ft.
	0502	10.0
0752	13.0	0.7
1102	22.0	1.8
1202	24.0	2.1
1502	30.0	3.1
1752	35.0	4.2
2002	40.0	5.5
2502	50.0	8.0
3002	60.0	11.5
3502	*40.0	8.5
4002	*46.0	11.0
4502	*52.0	14.0
5002	*57.0	16.5
4524	*52.0	14.0
5024	*57.0	16.5
6024	*68.0	25.0

*Flow for 15°F rise at high fire

Condensing Venting

Model	Outdoor	Vent ("V") Diameter Inches		
		Cat. IV Up to 50 ft	Cat. IV Up to 100 ft	Cat. II
0502	4	4	6	5
0752	6	6	8	6
1102	6	6	8	7
1202	6	6	8	7
1502	7	7	10	8
1752	7	7	10	8
2002	8	8	12	9
2502	8	8	12	9
3002	8	8	12	10
3502	9	9	14	12
4002	9	9	14	12
4502	10	10	14	12
5002	10	10	14	12
4524	10	10	14	12
5024	10	10	14	12
6024	12	12	14	12

Input & Output (MBTUH)

Model	Condensing	
	Input	Output
0502	500	475
0752	750	713
1102	1100	1045
1202	1200	1140
1502	1500	1425
1752	1750	1663
2002	2000	1900
2502	2500	2375
3002	3000	2850
3502	3500	3325
4002	4000	3800
4502	4500	4275
5002	4999	4749
4524	4500	4275
5024	4999	4749
6024	6000	5700

Shipping Weight (LBS)

Model	Condensing
0502	593
0752	678
1102	704
1202	770
1502	899
1752	963
2002	999
2502	1085
3002	1120
3502	1130
4002	1380
4502	1500
5002	1720
4524	1610
5024	1815
6024	2210

Current drawn by Boiler @ 115 Volts Single Phase 60 Hz

Model	Max Amps Draw – Boiler Only
0502	7
0752	7
1102	7
1202	7
1502	11
1752	11
2002	11
2502	14

Current drawn by Boiler @ 230 Volts 60 Hz

Model	Max Amps Draw – Boiler Only	Phase
3002	14	Single
3502	16	Single
4002	16	Single
4502	24	Single
5002	18	Three
4524	24	Single
5024	18	Three
6024	18	Three

Model #: _____ # Of Units: _____ Type of Gas: _____ Total Input _____ BTU/hr
 Total Output _____ BTU/hr Flow _____ USGPM @ Allowable Pressure Drop _____ Ft.
 Optional Accessories: _____